




DISCLAIMER:

The use of this standard is governed by the City of Wichita Falls Engineering Department. No warranty of any kind is made by the City of Wichita Falls for any purpose whatsoever. The City of Wichita Falls assumes no responsibility for the conversion of this standard to other formats for incorrect results or damages resulting from its use.

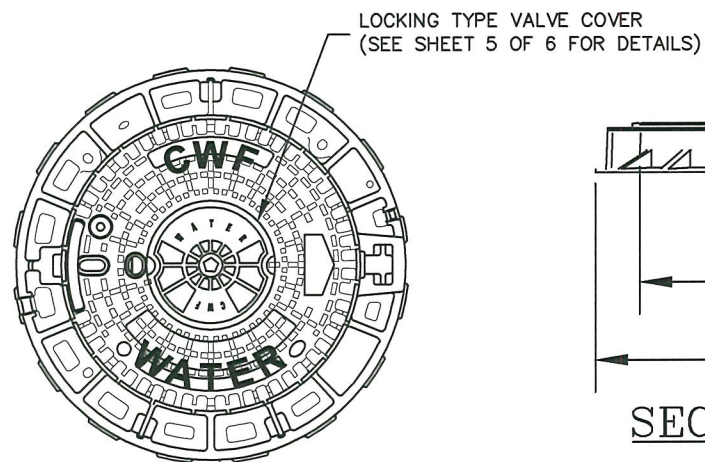


TOP VIEW
NOT TO SCALE

PAMREX/PAMTIGHT® OR APPROVED EQUAL
HINGED MANHOLE COVER DUCTILE IRON
FRAME AND COVER LABELED "GWF WATER"
SET TO ELEVATION SHOWN ON
PLAN AND PROFILE SHEETS

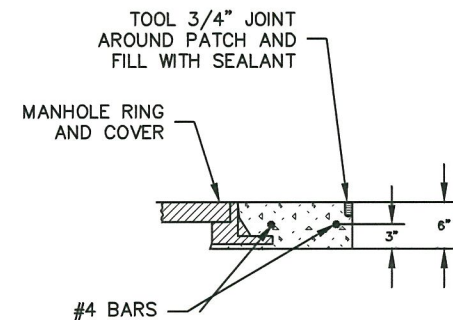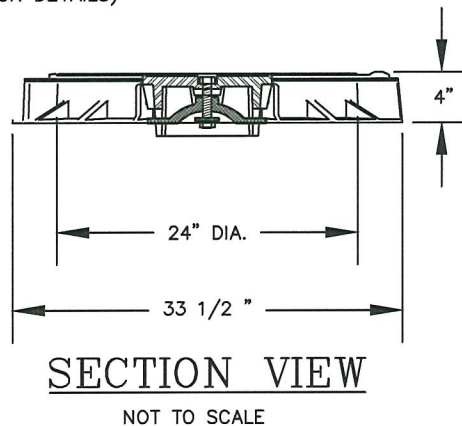

SECTION A-A
NOT TO SCALE

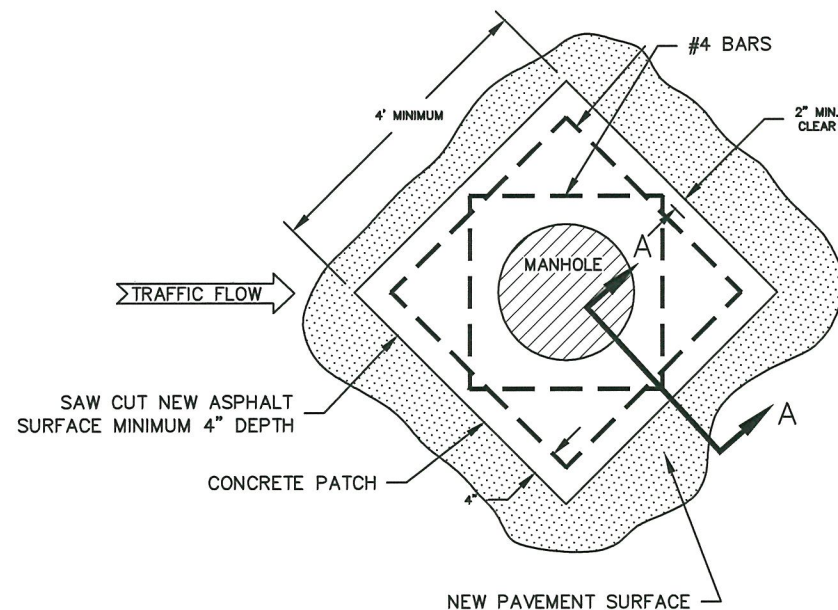**NOTES:**

1. CONTRACTOR SHALL PROTECT WATER MAINS FROM CONSTRUCTION DEBRIS.
2. RING SHALL BE THOROUGHLY GROUTED IN PLACE PRIOR TO PLACING CONCRETE PATCH.
3. NEW VAULT COVER AND FRAME SHALL BE PAMREX/PAMTIGHT® OR APPROVED EQUAL. COVER AND RING SHALL BE MANUFACTURED FROM DUCTILE IRON.

WATER METER VAULT MANHOLE COVER

NOT TO SCALE

TYPICAL METER AND BOX INSTALLATION (SHEET 6 OF 6)

FEB 06

DATE DRAWN

4170-06

STANDARD DRAWING NO.

CITY OF WICHITA FALLS, TX

Meter-Box1.dwg

ACAD DRAWING NAME

| NO. | DATE | DESCRIPTION | BY |
|-----|------|-------------|----|
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |

APPROVED

Scott Taylor
CITY ENGINEER

FEB 2006
DATE